


Model	P3C21AJSR05210F	P3C22AJSR05210F	P3C23AJSR05210F	P3C24AJSR05210F	P3C25AJSR06310F	P3C26AJSR06310F	P3C27AJSR07510F	P3C28AJSR09210F	P3C29AJSR12510F	P3C2AAJSR12510F	P3C2BAJSR12510F
Size	1/4 NPT	3/8 NPT	1/2 NPT	3/4 NPT	1 NPT	1 1/4 NPT	1 1/2 NPT	2 NPT	2 1/2 NPT	3 NPT	4 NPT
Cv	10	16	37	68	109	185	268	486	843	1150	2055
WOG	1000 psi	1000 psi	1000 psi	1000 psi	1000 psi	1000 psi	1000 psi	1000 psi	1000 psi	1000 psi	1000 psi
A	2.17	2.36	2.95	3.15	3.54	4.33	4.72	5.51	7.28	8.07	9.45
B	0.31	0.39	0.59	0.79	0.98	1.26	1.5	1.97	2.56	2.99	3.94
C	1.59	1.59	1.59	1.77	1.87	2.19	2.57	2.87	4.13	4.39	5.35
D	5.29	5.29	5.29	5.47	6.12	6.44	7.29	8.38	11.02	11.28	12.24
E	2.79	2.79	2.79	2.79	3.19	3.19	3.70	4.24	5.42	5.42	5.42
F	6.24	6.24	6.24	6.24	7.48	7.48	8.15	10.20	13.39	13.39	13.39
G	3.70	3.70	3.70	3.70	4.25	4.25	4.72	5.51	6.89	6.89	6.89
Sized for Max. Δ PSI	500 psi	500 psi	500 psi	500 psi	500 psi	300 psi	300 psi	300 psi	300 psi	300 psi	300 psi
Actuator	HP052SR10F	HP052SR10F	HP052SR10F	HP052SR10F	HP063SR10F	HP063SR10F	HP075SR10F	HP092SR10F	HP125SR10F	HP125SR10F	HP125SR10F
Ambient Temp	-4° / 176°F	-4° / 176°F	-4° / 176°F	-4° / 176°F	-4° / 176°F	-4° / 176°F	-4° / 176°F	-4° / 176°F	-4° / 176°F	-4° / 176°F	-4° / 176°F
Media Temp	-4° / 235°F	-4° / 235°F	-4° / 235°F	-4° / 235°F	-4° / 235°F	-4° / 235°F	-4° / 235°F	-4° / 235°F	-4° / 235°F	-4° / 235°F	-4° / 235°F
Wt. lbs	3.50	3.50	3.50	4.00	6.60	7.70	13.20	21.10	45.80	52.60	76.20

FOR APPLICATIONS EXCEEDING LISTED TEMPERATURES, CALL TO DISCUSS OPTIONS

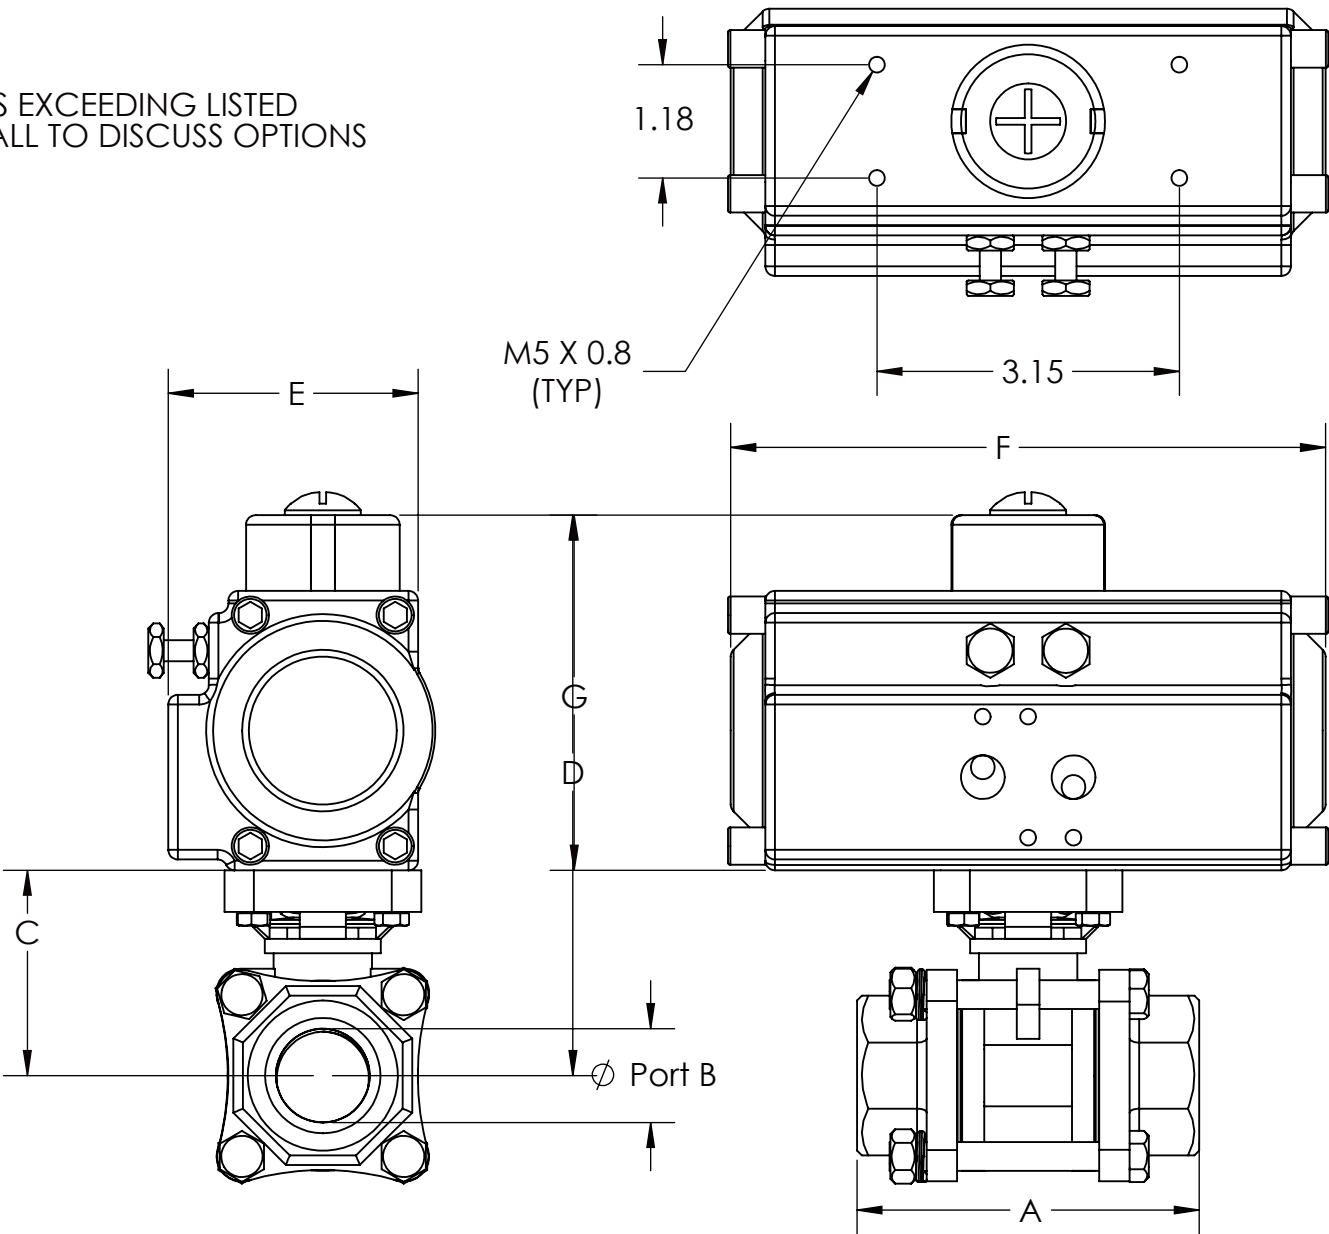

Valve Data

Body/End Cap	ASTM A216-WCB (Carbon Steel)
Stem	316 Stainless Steel
Ball	316 Stainless Steel
Seats	RTFE
Thrustwasher	PTFE
Stem Seal	PTFE / VITON O-Ring

UNCONTROLLED
DRAWING

THIS PRINT IS THE PROPERTY
OF DYNAQUIP CONTROLS AND
SHALL NOT BE COPIED,
REPRODUCED,LOANED,
OR DISPOSED OF DIRECTLY
OR INDIRECTLY, NOR USED
FOR ANY PURPOSE OTHER THAN
THAT FOR WHICH IT IS
SPECIFICALLY FURNISHED
EXCEPT BY WRITTEN
PERMISSION OF
DYNAQUIP CONTROLS.

NO.

P3 Series

FILE NO.
Sub295

TITLE

Ball Valve CS
Full Port - NPT
HP-SR NO Actuator

DR
CMM

DATE
12-07-22

CH'KD
P T S

DATE
06-22-16

ENGR
P T S

DATE
06-22-16