

Model	PHH23ATUSR0209F	PHH24ATUSR0209F	PHH25ATUSR0209F	PHH26ATUSR03410F	PHH27ATUSR0759F	PHH28ATUSR0759F	PHH2AATUSR1059F	PHH2BATUSR1579F
Size	1/2 NPT	3/4 NPT	1 NPT	1 1/4 NPT	1 1/2 NPT	2 NPT	3 NPT	4 NPT
Cv	19	34	52	77	143	205	260	410
CWP	600 PSI	600 PSI	600 PSI	600 PSI	600 PSI	600 PSI	600 PSI	600 PSI
A	2.60	2.93	3.56	4.09	4.60	5.31	6.89	8.03
B	0.59	0.79	0.98	1.26	1.57	1.97	3.00	3.74
C	1.34	1.72	2.06	2.56	3.12	3.78	5.35	6.35
D	1.22	1.52	1.67	1.94	2.44	2.71	3.85	4.59
E	4.84	5.14	5.29	6.19	7.52	7.79	9.23	10.62
F	2.81	2.81	2.81	3.27	4.06	4.06	4.27	4.90
G	5.79	5.79	5.79	6.50	8.19	8.19	10.31	10.63
H	3.62	3.62	3.62	4.25	5.08	5.08	5.38	6.03
Sized for Max Δ P	300 PSIG	300 psig	300 psig	300 psig	300 psig	300 PSIG	300 PSIG	300 PSIG
Actuator	UP020SR9F	UP020SR9F	UP020SR9F	UP034SR10F	UP075SR9F	UP075SR9F	UP105SR9F	UP157SR9F
Ambient Temp	-4°F / 176°F	-4°F / 176°F	-4°F / 176°F	-4°F / 176°F	-4°F / 176°F	-4°F / 176°F	-4°F / 176°F	-4°F / 176°F
Media Temp	-4° / 235°F	-4° / 235°F	-4° / 235°F	-4° / 235°F	-4° / 235°F	-4° / 235°F	-4° / 235°F	-4° / 235°F
Wt. lbs	4.00	4.31	5.11	7.57	12.20	14.94	24.75	36.75

FOR APPLICATIONS EXCEEDING LISTED
TEMPERATURES, CALL TO DISCUSS OPTIONS




FOR USE WITH POTABLE WATER

VALVE SIZES 1/2 THROUGH 1 1/2 ARE CERTIFIED
TO NSF/ANSI 372 AND NSF/ANSI 61 FOR USE WITH
POTABLE WATER

Note:
Sized for clean water, air, or oil.
Minimum 80 psig air supply to actuator.
Other applications may require larger actuators.
Please consult factory.

VALVE DATA

Body/End Cap	Forged Brass, Not Plated
Stem	Brass, Nickel Plated
Ball	Brass, Chrome Plated
Seats (<1", 2")	PTFE Graphite filled 15%
Seats (1"-1.5")	PTFE Carbographite
Seats (3"-4")	PTFE
Thrustwasher	<3" PTFE Carbon filled 25%; 3"+ PTFE
Stem Seal	FPM O-Rings
Ball Seat Seals	FPM O-Rings

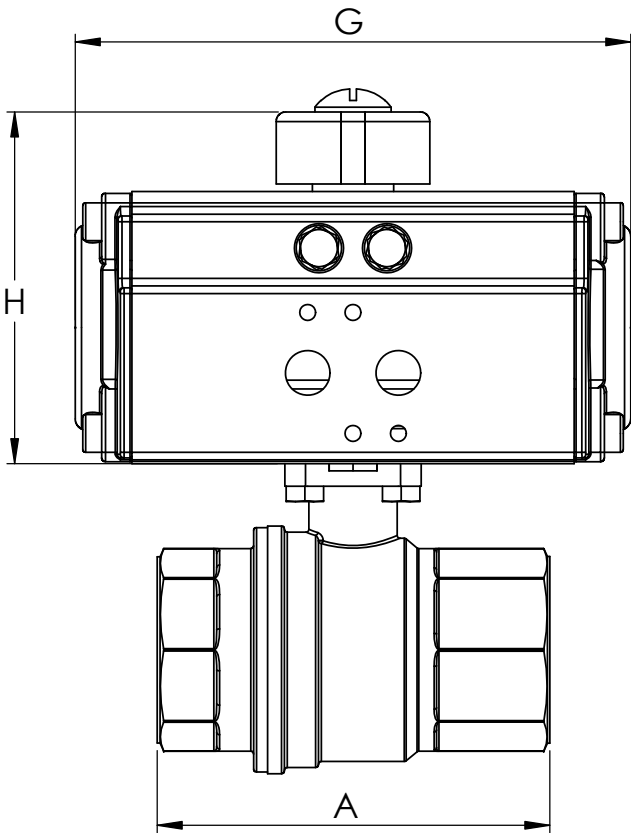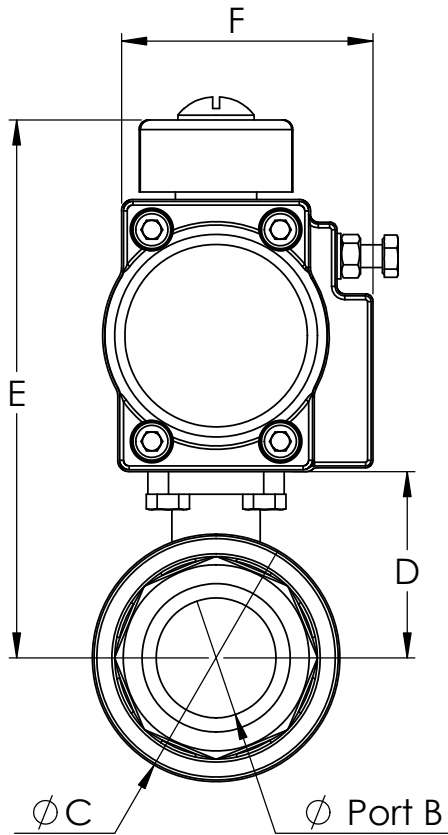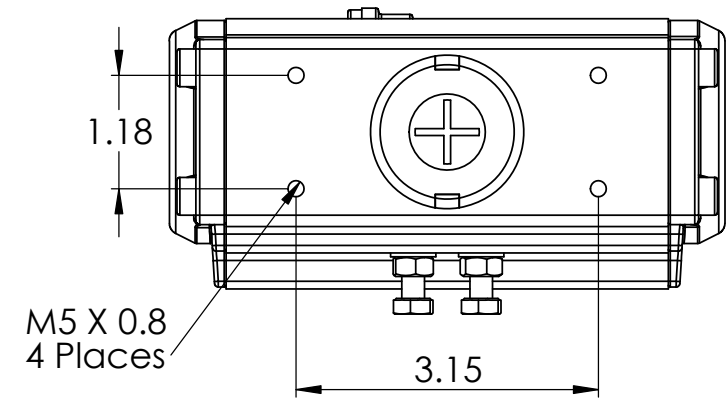

UNCONTROLLED
DRAWING

THIS PRINT IS THE PROPERTY
OF DYNAQUIP CONTROLS AND
SHALL NOT BE COPIED,
REPRODUCED, LOANED,
OR DISPOSED OF DIRECTLY
OR INDIRECTLY, NOR USED
FOR ANY PURPOSE OTHER THAN
THAT FOR WHICH IT IS
SPECIFICALLY FURNISHED
EXCEPT BY WRITTEN
PERMISSION OF
DYNAQUIP CONTROLS.

NO. PHH2 SERIES

FILE NO.
Sub544

TITLE
BALL VALVE - BRASS
FULL PORT - NPT
UP-SR NO ACTUATOR

DR	DATE	CHKD	DATE	ENGR	DATE
MJP	08-12-25	MDC	08-22-24	MDC	08-22-24

DynaQuip®
CONTROLS CORPORATION